

BOARD OF
BUILDING AND SAFETY
COMMISSIONERS

MARSHA L. BROWN
PRESIDENT

VAN AMBATIELOS
VICE-PRESIDENT

VICTOR H. CUEVAS
HELENA JUBANY
ELENORE A. WILLIAMS

CITY OF LOS ANGELES
CALIFORNIA



ANTONIO R. VILLARAIGOSA
MAYOR

DEPARTMENT OF
BUILDING AND SAFETY
201 NORTH FIGUEROA STREET
LOS ANGELES, CA 90012

ROBERT R. "BUD" OVROM
GENERAL MANAGER

RAYMOND S. CHAN, P.E., S.E.
EXECUTIVE OFFICER

Sweet's Joists, Incorporated
118 Borovec Road
Chehalis, Washington 98532

Attn: Bruce Howard
(360) 748-9376

RESEARCH REPORT: RR 25824
(CSI #06170)

BASED UPON ICC EVALUATION SERVICE
REPORT NO. ESR-2974

REEVALUATION DUE DATE:
September 1, 2012
Issued Date: June 1, 2011
Code: 2011 LABC

GENERAL APPROVAL – Reevaluation - Web-i® Wood I-Joists.

DETAILS

The above assemblies and/or products are approved when in compliance with the description, use, identification and findings of Evaluation Report No. ESR-2974, reissued July 1, 2011, of the ICC Evaluation Service, Incorporated. The report, in its entirety, is attached and made part of this general approval.

The parts of Evaluation Report No. ESR-2974 marked by an asterisk are modified or deleted by the Los Angeles City Building Department from this approval.

The approval is subject to the following conditions:

1. In addition to the identification method described in the ICC ESR report, each truss shall also be identified with the name "Los Angeles City Research Report No. 25824" stamped at the bottom portion of the lower chord.
2. Lumber for the truss fabrication shall bear the grademark and machine symbol of a Los Angeles City approved lumber grading agency. When it is necessary to cut board into shorter lengths and the grading symbol may be lost, occasional omission of the matching symbol will be permitted where approved by the Department inspector.
3. Bridging shall be provided as required structurally.

RR 25824
Page 1 of 2

Sweet's Joists, Incorporated
RE: Web-i[®] Wood I-Joists

4. Deflection of the truss shall be limited in accordance with the Code for wood members.
5. Bearing lengths of flanges (other than Douglas Fir Larch) of Web-I joist shall be designed for compression perpendicular to grain pursuant to Section 3.10.2 of NDS-2005.
6. Design calculations and details for specific applications, demonstrating that the wood I-Joists comply with this report, must be submitted to the Structural Plan Check Section. The design calculations and details for specific applications must be prepared and signed by a State of California Licensed Civil or Structural Engineer.

DISCUSSION

Condition 2 was removed due to change in the 2011 Los Angeles Building Code.

The report is in compliance with the 2011 Los Angeles City Building Code.


The approval is based on tests in accordance with ICC-ES Acceptance Criteria AC14.

The Web-i[®] Wood I-Joists were previously approved in LARR 24189.

This general approval will remain effective provided the Evaluation Report is maintained valid and unrevised with the issuing organization. Any revisions to the report must be submitted to this Department, with appropriate fee, for review in order to continue the approval of the revised report.

This general approval of an equivalent alternate to the Code is only valid where an engineer and/or inspector of this Department has determined that all conditions of this approval have been met in the project in which it is to be used.

Addressee to whom this Research Report is issued is responsible for providing copies of it, complete with any attachments indicated, to architects, engineers and builders using items approved herein in design or construction which must be approved by Department of Building and Safety Engineers and Inspectors.



WILLIAM STUTSMAN, Chief
Engineering Research Section
201 N. Figueroa St., Rm 880
Los Angeles, CA 90012
Phone (213) 202-9812
Fax (213) 202-9943

BG: bg
RR25824/MSWord.2007
R06/05/11
2/4/2303.1.2

Attachment: ICC ES Report No. ESR-2974 (6 Pages).

ICC-ES Evaluation Report**ESR-2974**

Reissued July 1, 2011

This report is subject to renewal in one year.www.icc-es.org | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

**DIVISION: 06 00 00—WOOD, PLASTICS AND
COMPOSITES****Section: 06 17 33—Wood I-joists****REPORT HOLDER:****SWEET'S JOISTS, INC.**
118 BOROVEC ROAD
CHEHALIS, WASHINGTON 98532
(360) 748-9376
www.webjoist.com
Bruce@Webjoist.com**ADDITIONAL LISTEE:****WEB JOIST NORTHWEST CORP.**
118 BOROVEC ROAD
CHEHALIS, WASHINGTON 98532
(360) 748-1173**EVALUATION SUBJECT:****WEB-i® WOOD I-JOISTS****1.0 EVALUATION SCOPE****Compliance with the following codes:**

- 2009 *International Building Code*® (2009 IBC)
- 2009 *International Residential Code*® (2009 IRC)
- 2006 *International Building Code*® (2006 IBC)
- * ■ 2006 *International Residential Code*® (2006 IRC)

Properties evaluated:

- Structural
- Fire resistance

2.0 USES

The WEB-i wood I-joists described in this report are used as structural framing members in floor and roof assemblies. The structural capacities and design provisions of the WEB-i wood I-joists comply with IBC Section 2303.1.2 for allowable stress design, and IRC Section R502.1.4.

3.0 DESCRIPTION**3.1 General:**

The WEB-i joists are prefabricated wood I-joists with lumber flanges and oriented strand board (OSB) webs. The flanges are solid-sawn lumber with glued finger-joints,

which are manufactured and tested daily in accordance with the manufacturer's quality control manual, to form continuous flanges. The face grain of the OSB web is oriented vertically, and the web-to-flange and web-to-web connections are proprietary, glued, tongue-and-groove joints. Joist depths vary from 11⁷/₈ to 28 inches (302 to 711 mm). See Table 1 and Figure 1 for joist descriptions.

3.2 Materials:

3.2.1 Flanges: Flange material is 1¹/₂-by-3¹/₂-inch (38 by 89 mm) machine-stress-rated (MSR) lumber meeting the grading rules specified in Table No. 4C of the NDS and in the manufacturer's quality control manual. Lumber species are Douglas fir-larch, hem-fir, spruce-pine-fir, Englemann spruce/lodgepole pine or lodgepole pine.

3.2.2 Webs: Webs are ³/₈- or ¹/₂-inch-thick (9.5 or 12.7 mm) OSB panels conforming with Structural I, Exposure I, performance-rated panel requirements as noted in U.S. Department of Commerce Product Standard PS-2 and the manufacturer's quality control manual.

3.2.3 Adhesive: The adhesive is an exterior-type adhesive complying with ASTM D 2559 and Section 5.3.3 of ASTM D 5055-08a.

4.0 DESIGN AND INSTALLATION**4.1 Installation:**

Installation of the WEB-i wood I-joists described in this report must comply with the applicable code requirements, this report and manufacturer's published installation instructions. The manufacturer's published installation instructions must be available at the jobsite at all times during installation.

4.2 Design:

The WEB-i wood I-joists must be designed using accepted joist design principles and this report.

4.2.1 Allowable Capacity: Table 2 specifies allowable moments, shears, and stiffness (EI) for the WEB-i wood I-joists.

4.2.2 Web Stiffeners: Both sides of the web of joists that are 16 inches (406 mm) and deeper must have web stiffeners installed at all supports. Table 4 specifies web stiffener requirements. At locations where concentrated loads exceed 1,500 pounds (6.67 kN), both sides of the web require stiffeners for all joist depths. See Figure 2.

4.2.3 Lateral Support: The compression flange requires continuous lateral support, and the joist ends require restraint to prevent rollover.

4.2.4 Holes: Figure 3 shows allowable hole size and location of holes in the joist webs.

4.2.5 Duration of Load: Adjustments for duration of load according to Section 7.3.2 of the NDS apply to the WEB-i wood I-joists and their fastenings.

4.2.6 In-service Moisture Conditions: The I-joists must be installed in dry, covered conditions, where the in-service moisture content is less than 16 percent.

4.2.7 Repetitive-member Use: The repetitive member factor for WEB-i wood I-joists shall be taken as 1.0.

4.2.8 Beam Span: Beam span must comply with the code. Vertical shear calculations must include all loads within the span from centerline to centerline of bearing supports.

4.2.9 Deflection: Deflection of uniformly loaded, simple-span joists and joists with a concentrated load at mid-span are determined with the deflection formulae in Table 2.

4.2.10 Blocking Panels: WEB-i wood I-joists under bearing walls that are perpendicular to the joists must have full-depth solid blocking.

4.2.11 Bearing Length: Table 3 provides equations that determine allowable shear based on bearing length of the I-joists at simple-span end supports.

4.3 One-hour Fire-resistance-rated Roof and Floor-ceiling Assemblies:

WEB-i I-joists used in one-hour fire-resistance-rated roof and floor-ceiling assemblies must be installed in accordance with Section 4.2.2.4 of *ESR-1338*, or IBC Table 720.1(3) Item Nos. 21-1.1, and 23-1.1 through 28-1.1.

5.0 CONDITIONS OF USE

The WEB-i wood I-joists described in this report comply with, or are suitable alternatives to what is specified in, those codes listed in Section 1.0 of this report, subject to the following conditions:

5.1 Installation complies with this report, the manufacturer's published installation instructions and the applicable code. In the event of conflicts between the manufacturer's published installation instructions and this report, this report governs.

5.2 Structural design information for the use of the joists must be indicated on the construction documents submitted with the permit application. The construction documents and the design configurations must be consistent with this report, and must be prepared by a registered design professional where required by the statutes of the jurisdiction in which the project is to be constructed.

5.3 Cutting of the flanges of the joists is not permitted. Web openings in wood I-joists must conform to the requirements as specified in Section 4.2.4 of this report. Web opening conditions not covered in Section 4.2.4 of this report are outside the scope of this report.

5.4 Evaluation of the trusses and joists is limited to interior dry-use conditions. Dry conditions of use are those conditions of use represented by moisture content that is less than 16 percent in the wood I-joists.

5.5 The joists are manufactured by Web Joist Northwest Corp. in Chehalis, Washington, under a quality control program with inspections by PFS Corporation (AA-652).

6.0 EVIDENCE SUBMITTED

Data in accordance with the ICC-ES Acceptance Criteria for Prefabricated Wood I-joists (AC14), dated October 2007 (editorially revised February 2010).

7.0 IDENTIFICATION

Each WEB-i wood I-joist bears a stamped identification label with the product name (WEB-i Joist), manufacturer's name (Web Joist Northwest Corp.), manufacturer's city and state, evaluation report number (ICC-ES ESR-2974), and name of the inspection agency (PFS Corporation). In addition, the flanges of the I-joists are labeled with the applicable lumber grade stamp.

TABLE 1—WEB-I JOIST DESCRIPTION^{1,2,3}

Series Code Number	Flange Grade	Web Thickness (inches)	Depth Range (Inches)
4212	MSR 1650f-1.5E	$\frac{3}{8}$	11 $\frac{7}{8}$ -24
4312	MSR 1800f-1.6E	$\frac{3}{8}$	11 $\frac{7}{8}$ -24
4412	MSR 2100f-1.8E	$\frac{3}{8}$	11 $\frac{7}{8}$ -24
4512	MSR 2400f-2.0E	$\frac{3}{8}$	11 $\frac{7}{8}$ -24
4612	MSR 2700f-2.2E	$\frac{3}{8}$	11 $\frac{7}{8}$ -24
4712	MSR 2850f-2.3E	$\frac{3}{8}$	11 $\frac{7}{8}$ -24
4232	MSR 1650f-1.5E	$\frac{1}{2}$	16-28
4332	MSR 1800f-1.6E	$\frac{1}{2}$	16-28
4432	MSR 2100f-1.8E	$\frac{1}{2}$	16-28
4532	MSR 2400f-2.0E	$\frac{1}{2}$	16-28
4632	MSR 2700f-2.2E	$\frac{1}{2}$	16-28
4732	MSR 2850f-2.3E	$\frac{1}{2}$	16-28

For SI: 1 in = 25.4 mm.

¹Flange size is 2x4 (1.50"x3.50")

²Web is Structural I OSB

³Series code numbers: 1st digit = Flange size, 2nd digit = Flange grade, 3rd digit = Web thickness and 4th digit = Web material.

⁴Flanges are labeled with applicable grade stamp.

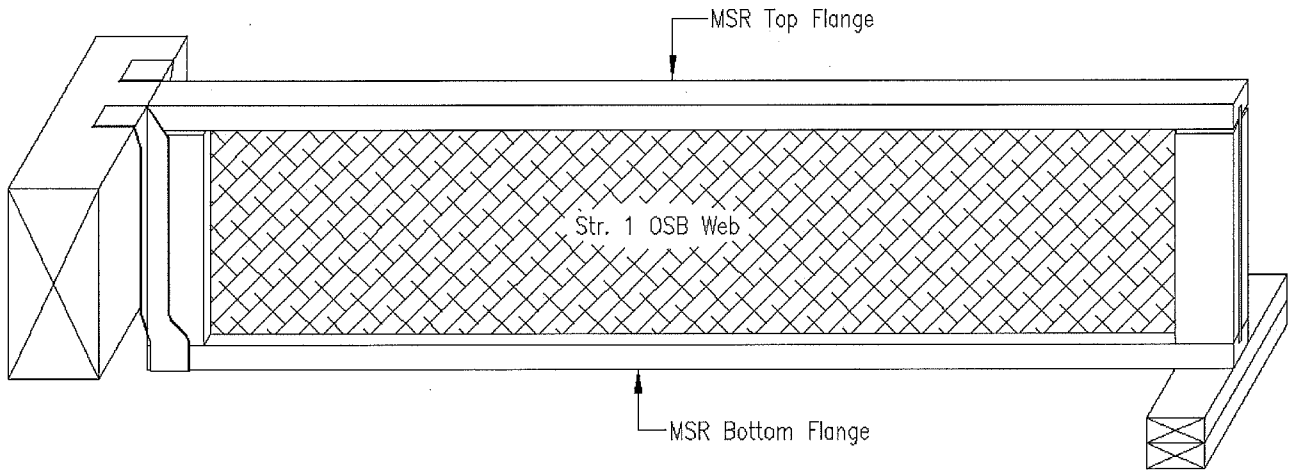
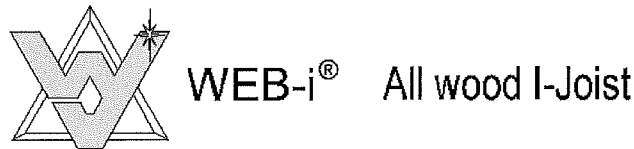


FIGURE 1—WEB-I COMPONENTS

TABLE 2—WEB-I JOIST PROPERTIES^{1,2,3,4}

Depth (in.)	Weight (plf)	Shear (lbs.)	Moment (Ft.-lbs.)	EI x 10 ⁶ (lbs.-in. ²)	K x 10 ⁶ (lbs.)	Depth (in.)	Weight (plf)	Shear (lbs.)	Moment (Ft.-lbs.)	EI x 10 ⁶ (lbs.-in. ²)	K x 10 ⁶ (lbs.)
WEB-i 4212 (2x4 1650f-1.5E Flange & 3/8" OSB Web)						WEB-i 4232 (2x4 1650f-1.5E Flange & 1/2" OSB Web)					
11 1/8	3.6	1,929	4,482	443	5.64	16	4.5	2,995	6,168	899	10.13
14	3.8	2,147	5,398	649	6.65	18	4.8	3,187	7,017	1,180	11.40
16	4.0	2,351	6,259	882	7.60	20	5.1	3,379	7,865	1,504	12.67
18	4.2	2,556	7,120	1,154	8.55	22	5.3	3,572	8,713	1,872	13.93
20	4.4	2,760	7,982	1,466	9.50	24	5.6	3,764	9,561	2,286	15.20
22	4.6	2,965	8,843	1,818	10.45	26	5.9	3,957	10,391	2,747	16.47
24	4.8	3,169	9,704	2,213	11.40	28	6.2	4,149	11,139	3,256	17.73
WEB-i 4312 (2x4 1800f-1.6E Flange & 3/8" OSB Web)						WEB-i 4332 (2x4 1800f-1.6E Flange & 1/2" OSB Web)					
11 1/8	3.6	1,929	5,164	473	5.64	16	4.5	2,995	7,106	959	10.13
14	3.8	2,147	6,218	693	6.65	18	4.8	3,187	8,083	1,259	11.40
16	4.0	2,351	7,210	941	7.60	20	5.1	3,379	9,060	1,604	12.67
18	4.2	2,556	8,202	1,231	8.55	22	5.3	3,572	10,037	1,997	13.93
20	4.4	2,760	9,195	1,563	9.50	24	5.6	3,764	11,014	2,438	15.20
22	4.6	2,965	10,187	1,940	10.45	26	5.9	3,957	11,970	2,930	16.47
24	4.8	3,169	11,179	2,361	11.40	28	6.2	4,149	12,831	3,473	17.73
WEB-i 4412 (2x4 2100f-1.8E Flange & 3/8" OSB Web)						WEB-i 4432 (2x4 2100f-1.8E Flange & 1/2" OSB Web)					
11 1/8	3.6	1,929	6,921	532	5.64	16	4.5	2,995	9,525	1,079	10.13
14	3.8	2,147	8,335	779	6.65	18	4.8	3,187	10,834	1,416	11.40
16	4.0	2,351	9,665	1,059	7.60	20	5.1	3,379	12,144	1,805	12.67
18	4.2	2,556	10,995	1,385	8.55	22	5.3	3,572	13,453	2,246	13.93
20	4.4	2,760	12,325	1,759	9.50	24	5.6	3,764	14,763	2,743	15.20
22	4.6	2,965	13,655	2,182	10.45	26	5.9	3,957	16,045	3,296	16.47
24	4.8	3,169	14,985	2,656	11.40	28	6.2	4,149	17,199	3,908	17.73
WEB-i 4512 (2x4 2400f-2.0E Flange & 3/8" OSB Web)						WEB-i 4532 (2x4 2400f-2.0E Flange & 1/2" OSB Web)					
11 1/8	3.6	1,929	8,459	591	5.64	16	4.5	2,995	11,641	1,199	10.13
14	3.8	2,147	10,187	866	6.65	18	4.8	3,187	13,242	1,574	11.40
16	4.0	2,351	11,812	1,176	7.60	20	5.1	3,379	14,843	2,005	12.67
18	4.2	2,556	13,438	1,539	8.55	22	5.3	3,572	16,443	2,496	13.93
20	4.4	2,760	15,063	1,954	9.50	24	5.6	3,764	18,044	3,048	15.20
22	4.6	2,965	16,689	2,425	10.45	26	5.9	3,957	19,611	3,662	16.47
24	4.8	3,169	18,315	2,951	11.40	28	6.2	4,149	21,021	4,342	17.73
WEB-i 4612 (2x4 2700f-2.2E Flange & 3/8" OSB Web)						WEB-i 4632 (2x4 2700f-2.2E Flange & 1/2" OSB Web)					
11 1/8	3.6	1,929	9,448	650	5.64	16	4.5	2,995	13,002	1,319	10.13
14	3.8	2,147	11,377	952	6.65	18	4.8	3,187	14,790	1,731	11.40
16	4.0	2,351	13,193	1,294	7.60	20	5.1	3,379	16,577	2,206	12.67
18	4.2	2,556	15,008	1,693	8.55	22	5.3	3,572	18,365	2,746	13.93
20	4.4	2,760	16,824	2,150	9.50	24	5.6	3,764	20,153	3,352	15.20
22	4.6	2,965	18,640	2,667	10.45	26	5.9	3,957	21,903	4,028	16.47
24	4.8	3,169	20,455	3,246	11.40	28	6.2	4,149	23,478	4,776	17.73
WEB-i 4712 (2x4 2850f-2.3E Flange & 3/8" OSB Web)						WEB-i 4732 (2x4 2850f-2.3E Flange & 1/2" OSB Web)					
11 1/8	3.6	1,929	10,107	680	5.64	16	4.5	2,995	13,909	1,379	10.13
14	3.8	2,147	12,171	996	6.65	18	4.8	3,187	15,822	1,810	11.40
16	4.0	2,351	14,113	1,353	7.60	20	5.1	3,379	17,734	2,306	12.67
18	4.2	2,556	16,056	1,770	8.55	22	5.3	3,572	19,646	2,870	13.93
20	4.4	2,760	17,998	2,247	9.50	24	5.6	3,764	21,559	3,505	15.20
22	4.6	2,965	19,940	2,788	10.45	26	5.9	3,957	23,431	4,212	16.47
24	4.8	3,169	21,882	3,394	11.40	28	6.2	4,149	25,116	4,993	17.73

For SI: 1 in = 25.4 mm, 1 lbf = 4.448 N, 1 pli = 0.124 kg/m, 1 plf = 1.488 kg/m, 1 ft-lbf = 1.3558 N-m, 1 lbf-in² = 292.64 kg-mm².

¹Calculate bending and shear deflection as follows:
 Uniformly distributed load: Defl.(in.) = (5WL⁴ / 384EI) + (WL² / K)
 Concentrated load at centerline: Defl.(in.) = (PL³ / 48EI) + (2PL / K)
 Where: W = Uniform load (plf) L = Span length (in.) EI = MOE times I (pounds-inches² x 10⁶)
 K = Shear defl. constant (pounds x 10⁶) P = Concentrated load (pounds)

²Allowable shear is lower of above value or bearing length value from equations in Table 3.

³See Table 4 for web stiffener requirements.

⁴Straight line interpolation may be made between depths.

TABLE 3—ALLOWABLE SHEAR FOR BEARING LENGTH¹

For $\frac{3}{8}$ " Web no Web Stiffeners	$V = 723.4 + 45.876D\sqrt{B}$
For $\frac{3}{8}$ " Web with Web Stiffeners	$V = 1353.8 + 39.672D\sqrt{B}$
For $\frac{1}{2}$ " Web with Web Stiffeners	$V = 1741.8 + 42.812D\sqrt{B}$

For SI: 1 in = 25.4 mm, 1 lbf = 4.448 N.

Where:

V = Allowable shear (Lb.)

D = Out to out depth of joist(In.)

B = Bearing length (In.) (B is not to be less than 1.50")

¹The allowable shear for bearing length is for normal duration of loading and may be increased for duration of loading in accordance with Section 7.3.2 of NDS.

TABLE 4—WEB STIFFENERS NAILING^{1,2,3}

Joist Depth (inches)	Total nails per stiffener location			
	Simple Span		Continuous Span	
	$\frac{3}{8}$ " Web	$\frac{1}{2}$ " Web	$\frac{3}{8}$ " Web	$\frac{1}{2}$ " Web
11 $\frac{7}{8}$	(Box) 3-10d*	(Com.) —	(Box) 4-10d	(Com.) —
14	4-10d*	—	6-10d	—
16	4-10d	4-10d	6-10d	6-10d
18	5-10d	5-10d	7-10d	7-10d
20	6-10d	6-10d	9-10d	9-10d
22	6-10d	6-10d	9-10d	9-10d
24	7-10d	7-10d	10-10d	10-10d
26	—	8-10d	—	12-10d
28	—	8-10d	—	12-10d

For SI: 1 in = 25.4 mm.

¹Web stiffeners are No.2 or better. Use 2x4's at simple spans and 2x6's at continuous spans. Install nails from both sides.

²May substitute 14 Ga. staples for 10d Box nail and 13 Ga. staples for 10d Common nail. Staples Min. are $\frac{7}{16}$ " crown and 3" leg.

³Web stiffeners not required for 11 $\frac{7}{8}$ " & 14" deep $\frac{3}{8}$ " web simple span ends but may be needed for bearing length requirements.

**U"-type hanger may require web stiffeners to comply with nailing requirements through side plates of hanger.


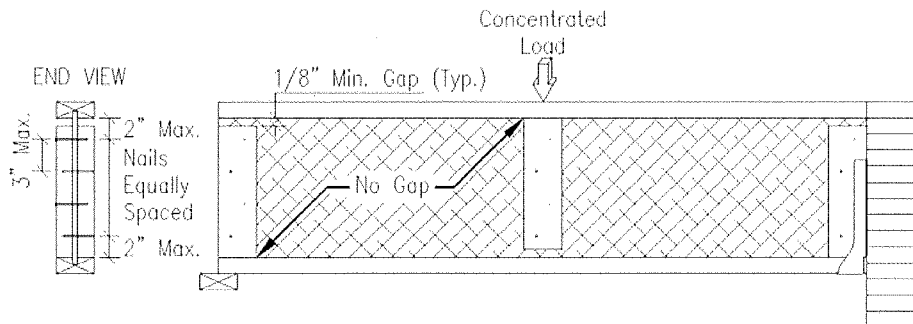


FIGURE 2—WEB STIFFENERS
For SI: 1 in = 25.4 mm.

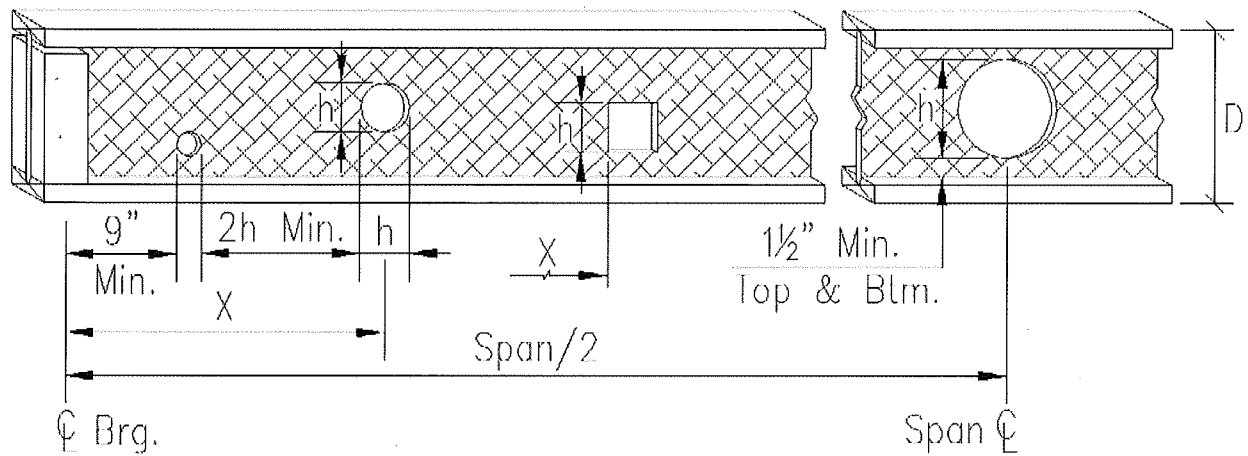

For simple spans and uniform load, the following formulas may be used to determine minimum distance to hole.

$$X = (V - V_H) / W \qquad V = WL / 2 \qquad V_H = V_A (D_E / D_W)$$

Where:

X = Minimum distance in feet from centerline of support to centerline of round hole or edge of square hole.

V = Shear at bearing in pounds.

W = Uniform loading in pounds per lineal foot.

L = Span in feet; From centerline of support to centerline of support.

V_H = Allowable shear at hole in pounds.

V_A = Allowable shear in pounds from Table 8

D_E = Effective depth at hole in inches (D_E can not be < 0.5").

@ Round hole D_E = D_W - h

@ Square hole D_E = D_W - (h/0.75)

@ Rectangular hole D_E = D_W - (h/0.6667)

D_W = Depth of web in inches = D - 1.75"

h = Height of hole in inches (h_{max} to be the lower of D-6" or a value that results in D_E being ≥ 0.5").

D = Out to out depth of joist in inches.

NOTES:

1.) Do not cut the web within nine inches of the support centerline, otherwise a two inch hole can be cut in the web anywhere. The top and bottom flanges are never to be cut.

2.) Where more than one hole is desired, the length of the web between edges of holes must be equal or exceed twice the height of the largest hole.

FIGURE 3—HOLE SIZE AND LOCATION

For SI: 1 in = 25.4 mm, 1 lbf = 4.448 N, 1 lbf/ft = 1.488 kg/m.